Click to go to centralboiler.com

Existing Boiler - Pressurized
(with Wraparound Pump)

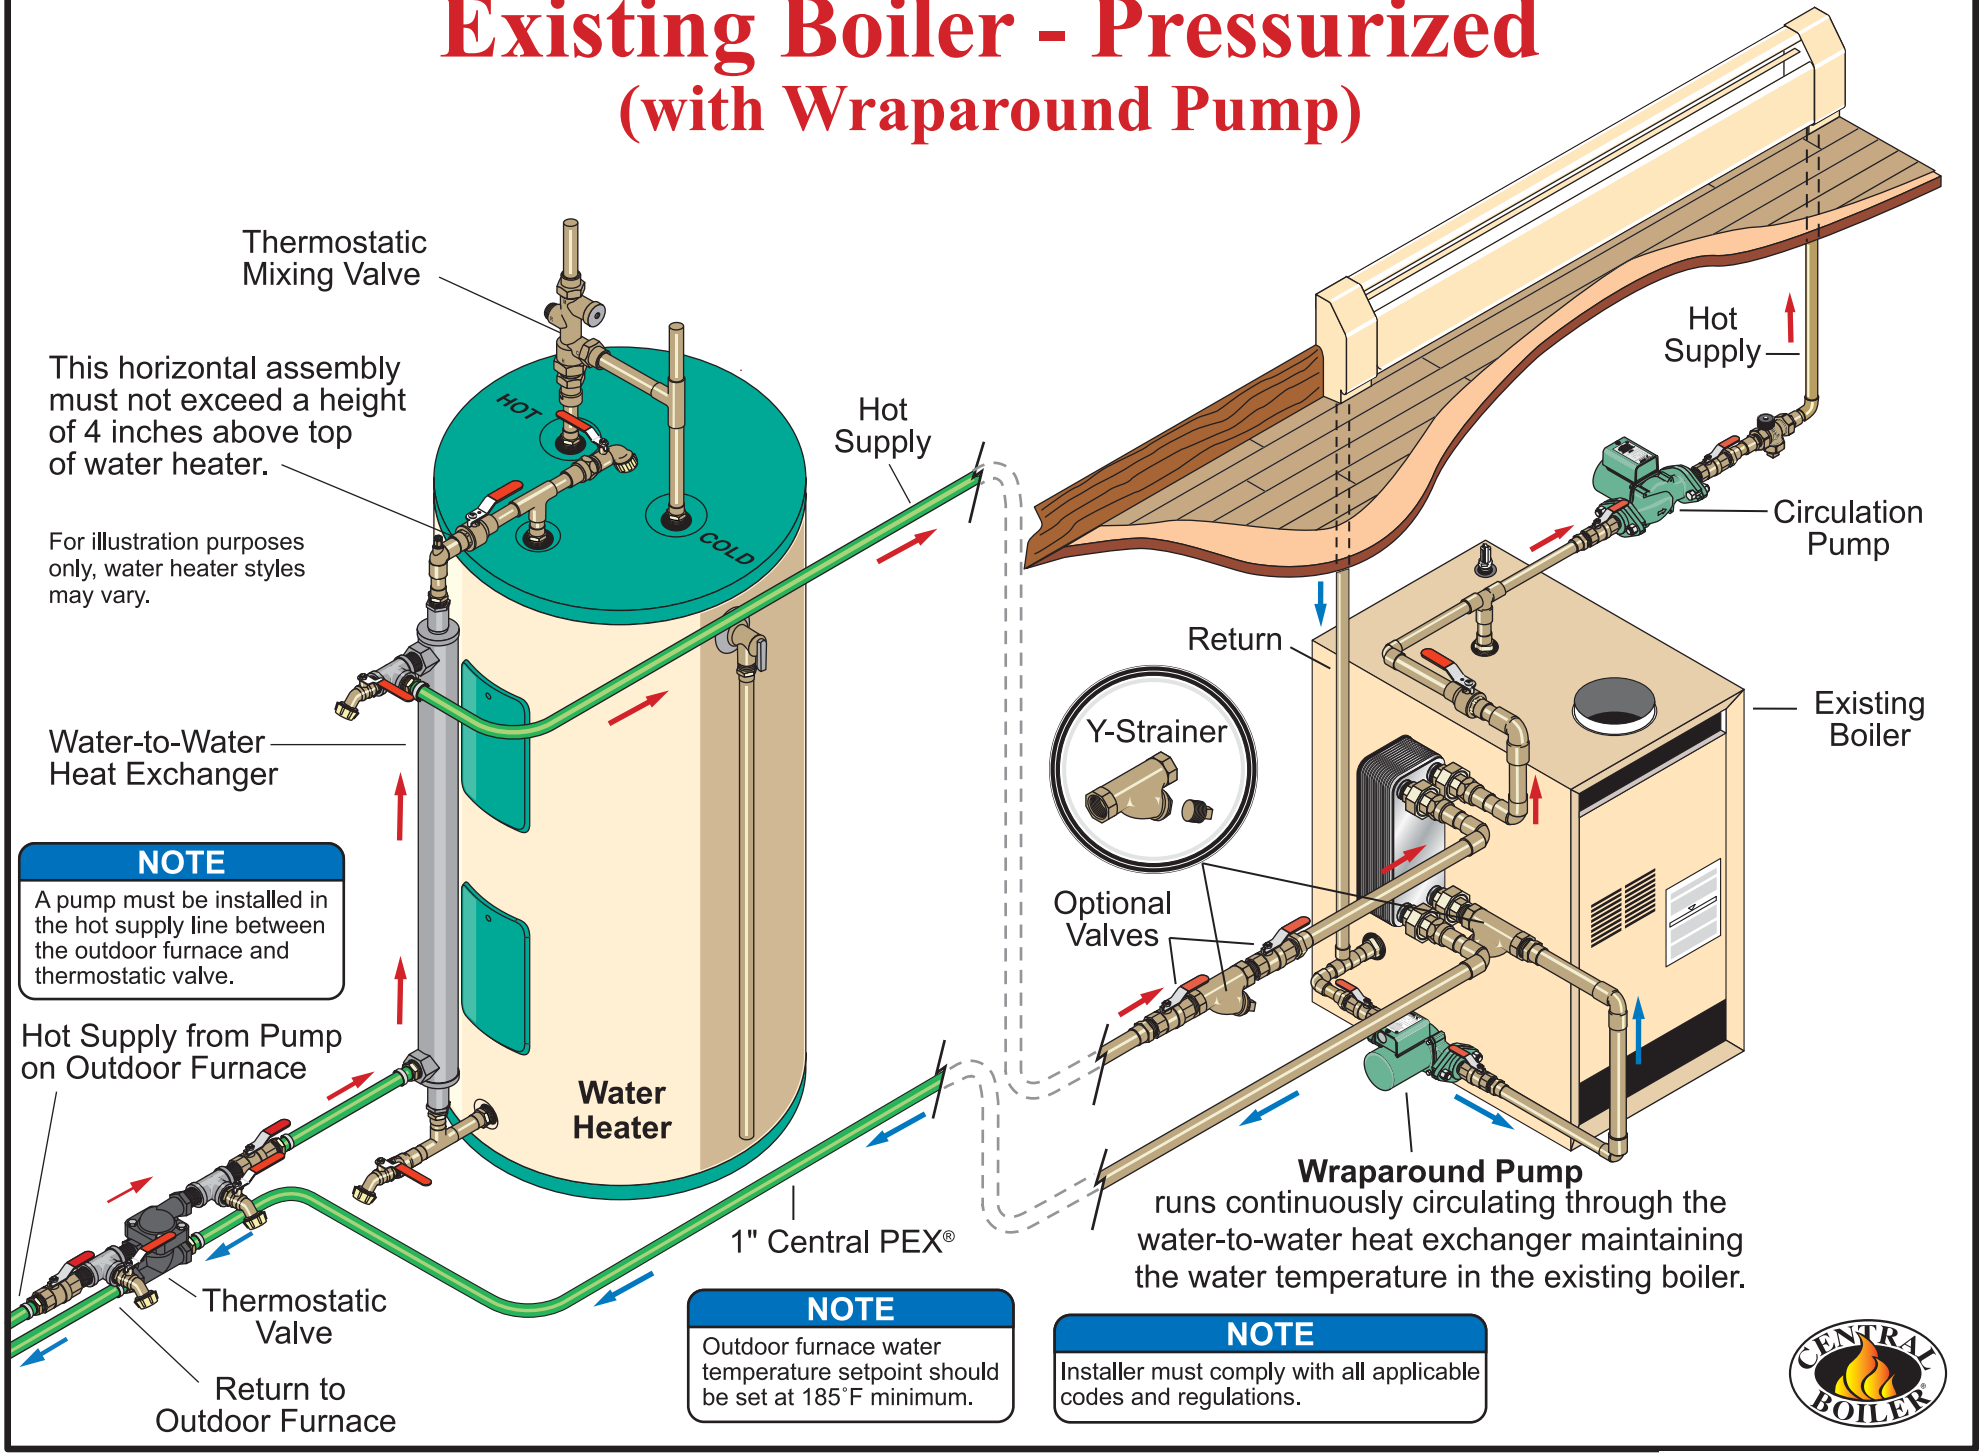

NOTE
A pump must be installed in the hot supply line between the outdoor furnace and thermostatic valve.

NOTE
Outdoor furnace water temperature setpoint should be set at 185˚F minimum.

NOTE
Installer must comply with all applicable codes and regulations.

© 2010 Central Boiler